



ARCHITECTURE • ENGINEERING • INTERIOR DESIGN

## ADDENDUM

**PROJECT:** Crawford County Memorial Hospital  
MRI Infill  
Denison, Iowa

### ADDENDUM NUMBER

AD-1

### ISSUED BY:

Wade Stange, Architect  
Bryce Johnson, Mechanical Engineer  
Jon Dalton, Electrical Engineer

**PROJECT #:** 11-0173

**DATE ISSUED:** Friday, December 16, 2011

*This addendum is issued by the Architect to all known bidders before receipt of proposals, for the purpose of explaining, interpreting, or modifying the original plans and specifications. When enumerated by the bidder upon the proposal sheet, the information or instructions given hereon will be equally binding upon all parties as if included in the original plans and specifications.*  
**BIDDER MUST ENTER THE NUMBER OF THIS ADDENDUM ON HIS PROPOSAL SHEET**

### THE FOLLOWING ITEMS ARE GENERAL INFORMATION

#### AD-1, ITEM 1:

Please note the following:

No ferrous metals are to be used in the MRI "box". Ceiling grid and hanger wires are to be aluminum. The aluminum ceiling grid can be 15/16" wide.

Existing handrails are InPro HR9 and corner guards are InPro 150 and 160. All colors/stains to match existing

### THE FOLLOWING ITEMS ARE APPLICABLE TO THE DRAWINGS:

#### AD-1, ITEM 2:

In reference to drawing Sheet E-101-E – Plan 1 and Plan 2, nurse call wall light in corridor does not exist. Omit reference to existing nurse call wall light. Nurse call code blue device does not exist. Omit reference to relocating existing nurse call code blue device within MRI room.

#### AD-1, ITEM 3:

In reference to drawing Sheet E-101-E – Plan 2, see attached Supplement Drawing E-101-E-1 for changes in light switching and keynotes.

**AD-1, ITEM 4:**

**In reference to drawing Sheet M-101-E - Remodel Plan HVAC and M-501-E - Diffuser, Register and Grille Schedule**, the following manufacturers may bid as "or equal" manufacturers to those specified or scheduled on the drawings for equipment as stated below; however; this does not relieve the supplier from providing products as specified or scheduled and, if products submitted do not meet the intent of the specification, they will be rejected.

Price Industries - Diffusers, Registers, and Grilles

Titus - Diffusers, Registers, and Grilles

**END AD-1**

**Title**

Electrical Changes

**Project**

Crawford County Memorial  
New MRI Room Infill  
Des Moines, Iowa

**DATE:**

12/15/11

**DRAWING:**

E-101-E-1

**FROM SHEET:**


E-101-E

**LINCOLN:**

211 NORTH 14TH STREET  
LINCOLN, NE 68508  
PHONE (402) 476-9700  
FAX: (402) 476-9722

**OMAHA:**

4245 SOUTH 143RD STREET  
OMAHA, NE 68137  
PHONE (402) 341-6600  
FAX: (402) 341-6611

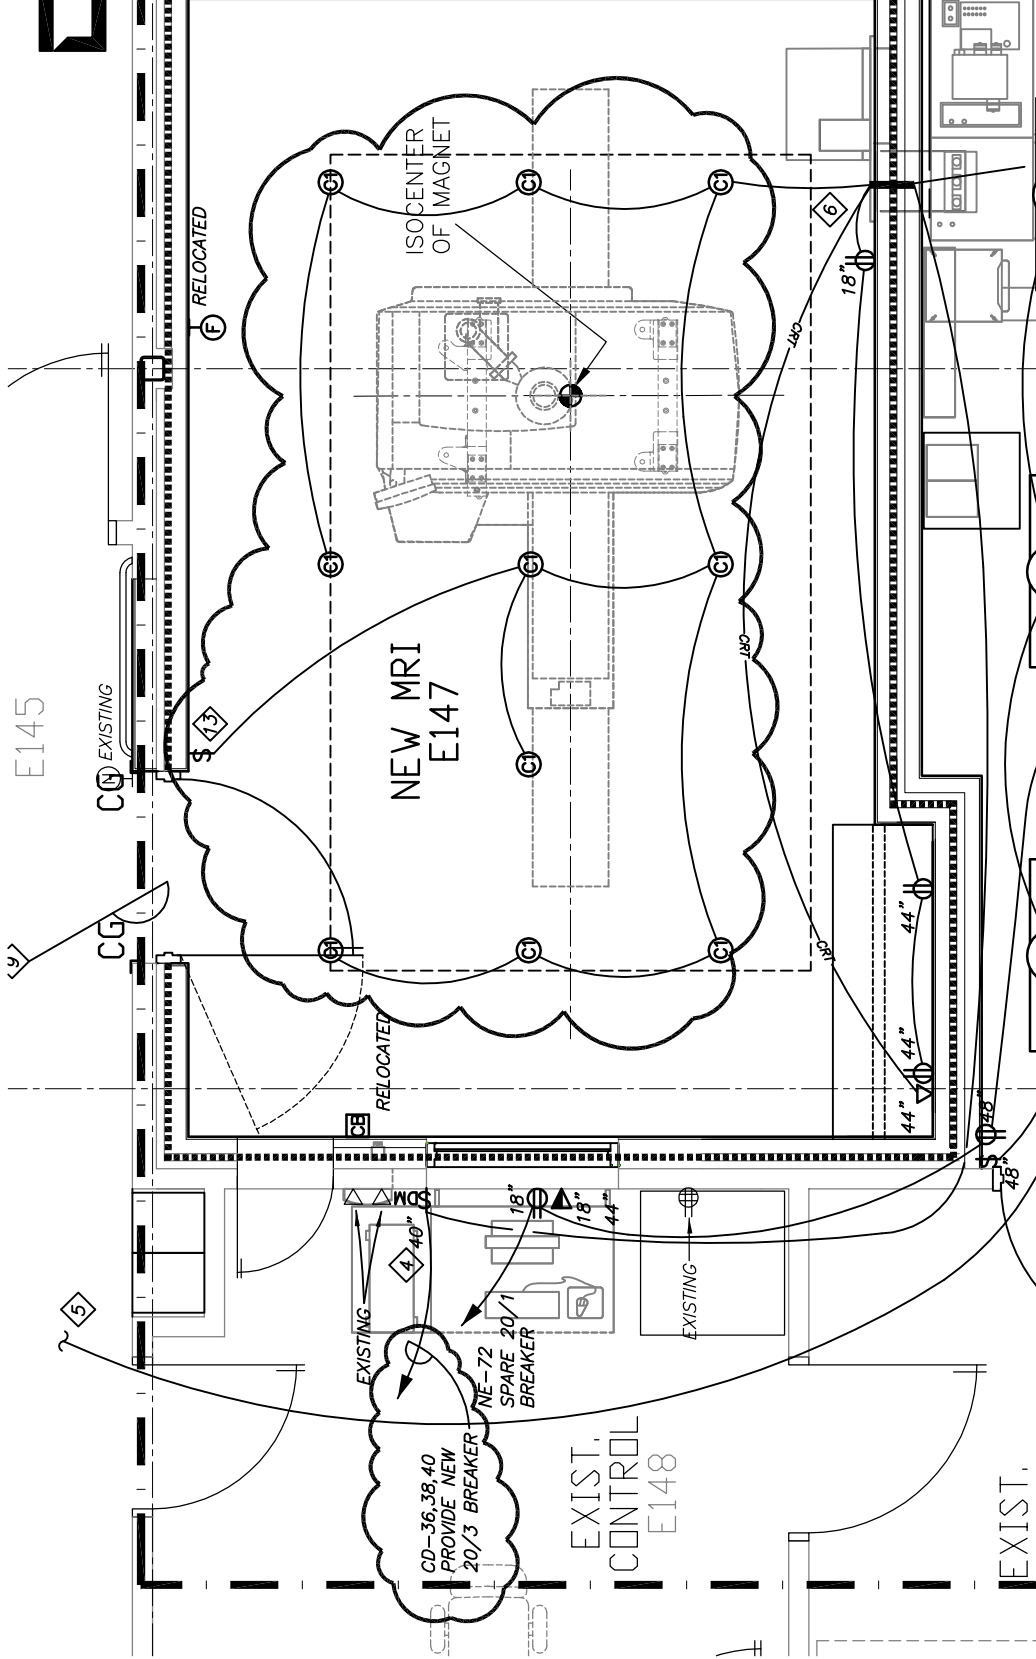

**2 Partial New Plan - Electrical**

Scale: 1/4" = 1'-0"

**ELECTRICAL PLAN  
KEYED NOTES:**

- 4 PROVIDE LEVITON OR EQUAL #82000, 2000W INCANDESCENT DIMMER. SWITCH TO BE DC RATED ALSO. COORDINATE COLOR OF DEVICE WITH EXISTING DEVICES IN HOSPITAL PRIOR TO ORDERING.
- 5 SEE SIEMENS MRI DRAWINGS FOR ADDITIONAL ELECTRICAL WORK. ON SIEMENS DRAWINGS WHEN EQUIPMENT OR WORK IS CALLED OUT BY EITHER CUSTOMER/CONTRACTOR OR CUSTOMER, THESE ITEMS WILL BE DONE BY THE ELECTRICAL CONTRACTOR. PROVIDE AC TO DC LIGHTING CONVERTER FOR MRI ROOM LIGHTS. COORDINATE BID QUESTIONS AND MRI WORK WITH DAVE ENGDALH. TELEPHONE NUMBER 1-402-960-7283, VOICE MESSAGE NUMBER 1-800-228-5462 (EXT. 1263), E-MAIL ADDRESS dengdahh@cassling.com.
- 6 PROVIDE LEVITON OR EQUAL #CSB1-20. SWITCH TO CONTROL LIGHTS OVER BED PART OF MRI. SWITCH TO BE DC RATED ALSO. COORDINATE COLOR OF DEVICE WITH EXISTING DEVICES IN HOSPITAL PRIOR TO ORDERING.
- 9