



DATE ISSUED December 12, 2012

ADDENDUM # 1

ENGINEER Engineering Technologies, Inc.
825 M Street, Suite 200
Lincoln, NE 68508

PROJECT Richardson County Courthouse
\*Water Chiller Replacement

ETI PROJECT # 2012-144

The Architect issues this Addendum to all known bidders before receipt of proposals. Bidder shall acknowledge the receipt of this addendum on their proposal sheet and all information contained herein shall become a part of the contract documents.

ADDENDUM:

GENERAL

- 1. See attached December 11, 2012 PRE-BID CONFERENCE ATTENDANCE sign in sheet (1 page total).

GENERAL ITEMS – MECHANICAL

- 1. Since each Chiller has different dimensions and access requirements, the grate system will have to be modified differently for each Chiller. The bid price shall include the modification cost required for a complete Chiller installation.
2. The operating weight of the original Carrier Chiller is cataloged at 3,158 pounds.

PRIOR APPROVAL – MECHANICAL

- 1. The following manufacturers have received prior approval for bidding purposes subject to shop drawing review:

Table with 2 columns: Equipment (Water Chillers) and Manufacturer (Trane, Carrier, York)

DRAWINGS – MECHANICAL

- 1. Sheet M2.1 Mechanical
A. Mechanical Equipment Schedule for Item #1 “Condensing Unit (CU-1) and Heat Exchanger (HE-1)”:
i. Delete fused disconnect from schedule. Fused disconnect is not available as an option for the specified unit. Fused disconnect will be provided by the Electrical Contractor.

DRAWINGS – ELECTRICAL


- 1. Sheet E1.1 Electrical
A. Provide and install fused disconnect for Condensing Unit (CU-1). See attached Drawing E1.1/E1 dated 12.12.2012.

END OF ADDENDUM




# **SHEET NOTES**

2. PROVIDE NEW CIRCUIT TO NEW CONDENSING UNIT, 3-1/0, #6 GND. IN 2" EMT. REUSE 150A/3P, 480V CIRCUIT BREAKER IN EXISTING 480V, 3Ø PANEL. PROVIDE NEW FUSED 200/3P 480V DISCONNECT SWITCH.

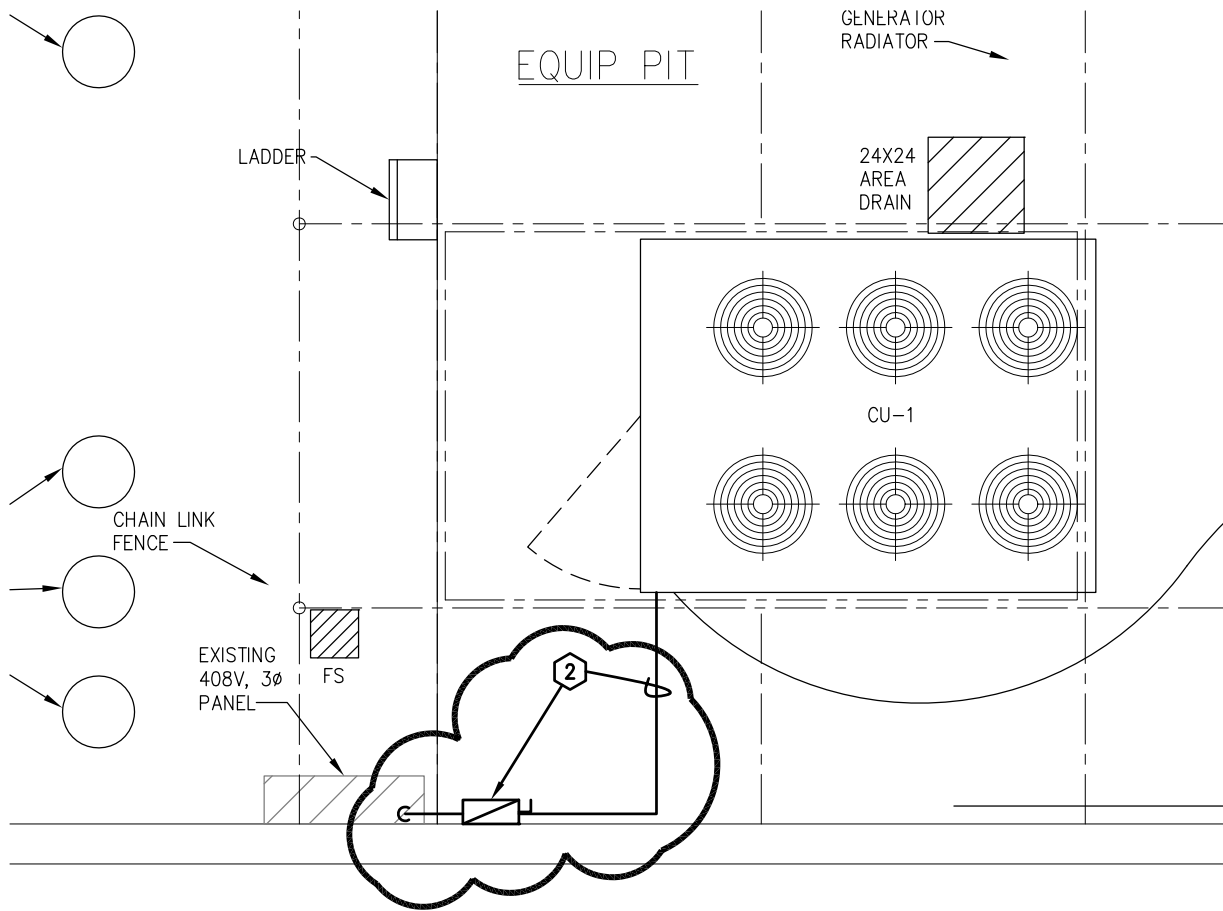

ETI ADDENDUM #1, page 3 of 3

RICHARDSON COUNTY  
COURTHOUSE  
LOWER LEVEL ELECTRICAL PLANS -  
DEMOLITION & NEW



**Engineering Technologies Inc.**  
Mechanical & Electrical Building Solutions  
825 M Street, Suite 200 | Lincoln, NE 68508  
P 402.476.1273 | F 402.476.1274  
4559 South 133rd Street | Omaha, NE 68137  
P 402.330.2772 | F 402.330.2630  
ETI Project No: (2012-144)

12/12/2012

SHEET  
E1.1

ATTACHMENT NO.

E1

MAB

SCALE: 1/4" = 1'-0"

ADDENDUM #1