



ARCHITECTURE • ENGINEERING • INTERIOR DESIGN

ADDENDUM

PROJECT: Broken Bow Airport
T-Hangar Expansion (Base Bid)
SRE Bldg Hangar Door Replacement (Alt Bid)
Broken Bow, Nebraska

ADDENDUM NUMBER

AD-1

ISSUED BY:

Michael D. Marsh, Architect

PROJECT #: 12-0183

DATE ISSUED: Tuesday, May 7, 2013

This addendum is issued by the Architect to all known bidders before receipt of proposals, for the purpose of explaining, interpreting, or modifying the original plans and specifications. When enumerated by the bidder upon the proposal sheet, the information or instructions given hereon will be equally binding upon all parties as if included in the original plans and specifications.


BIDDER MUST ENTER THE NUMBER OF THIS ADDENDUM ON HIS PROPOSAL SHEET

THE FOLLOWING ITEMS ARE APPLICABLE TO THE DRAWINGS:

AD-1, ITEM 1:

In reference to Sheet A-102, see attached Supplemental Drawing for locations of 6-10lb. ABC fire extinguishers. Furnish with manufactures wall mounting brackets typical all locations.

END AD-1

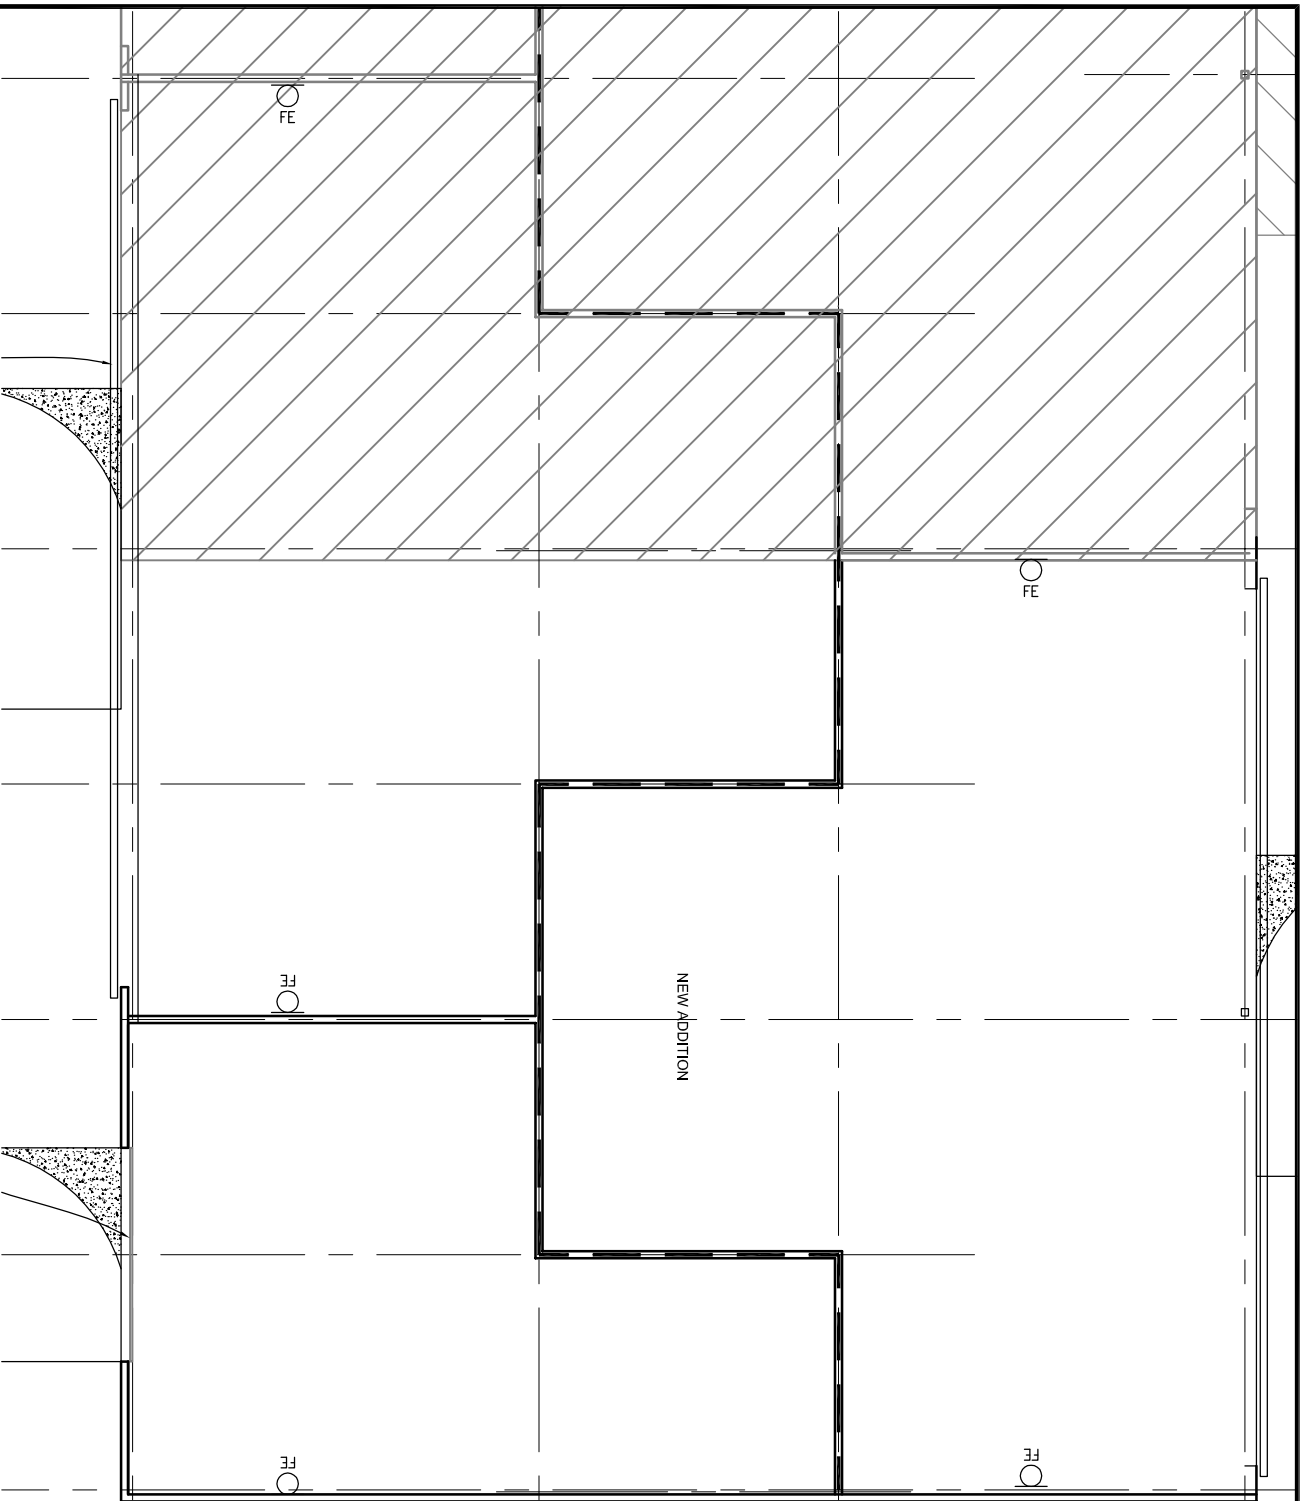

1

Fire Extinguisher Location Plan

Scale: Not To Scale

Lincoln
 1221 N Street, Suite 600
 Lincoln NE 68508
 Phone 402-476-9700
 Fax 402-476-9722

Vermillion
 15 East Main, Suite 201
 Vermillion SD 57069
 Phone 605-624-1081



Client Information
 Broken Bow
 Municipal
 Airport

Project Information
 "T"-Hanger
 Addition

| | |
|--|------------|
| Issue Date | 05-08-2013 |
| Job # | 12-0183 |
| Drawn by: | JD |
| CADD file: | |
| COPYRIGHT © DAVIS DESIGN ALL RIGHTS RESERVED | |

Drawing Title
 wall Mounted Fire Extinguisher
 Locations

From Sheet: A-102 for CA use:
 Drawing # A-102.1