

Addendum #1

Project Name: NDOR Equipment Storage Building and Wash Bay
Gordon, NE
SHA Project No.: 13017
NDOR Project No.: AFE K-500 (Building No. 50905)
Issued: February 17, 2014

This Addendum is issued by the Nebraska Department of Roads (NDOR) to all known bidders working on the preparation of proposals associated with the Bid Documents dated January 30, 2014. This Addendum is to authorize the use of the following information in preparing proposals for the above named project.

MODIFICATIONS TO THE SPECIFICATIONS

- ADD 1-1.** Refer to Section 066400 – Plastic Paneling, Article 2.1, paragraph A.1.a; Change paragraph to read:
- a. Kemply Pre-laminated, double sided FRP panel as manufactured by Crane Composites
- ADD 1-2.** Refer to Section 066400 – Plastic Paneling, Article 2.1, paragraph A.2; Change paragraph to read:
2. Glass-fiber reinforced plastic panel nominal thickness: Each plastic panel skin – not less than 0.09 inch (2.3.mm).
- ADD 1-3.** Refer to Section 066400 – Plastic Paneling, Article 2.1, paragraph A.3; Change paragraph to read:
3. Surface Finish: Molded pebble texture facing Wash Bay w/ smooth finish texture on opposite side of composite panel.

MODIFICATIONS TO THE DRAWINGS

- ADD 1-4** Refer to sheet A100 –Floor Plan, Schedules and Door Types; make the following changes:
1. Add new door opening 107C at the north end of the wash bay/equipment bay demising wall (see attached sketch A1 for clarification).
 2. Add Door 107C to the door schedule. Door 107C shall be a duplication of Door 107B in every respect.
- ADD 1-5** Refer to sheet E100 – First Floor Plan – Lighting; make the following changes:
1. Add exit sign and wall switches in Wash Bay 107 @ door opening 107C and add exit sign in Equipment Bay 106 @ door opening 107B (see attached sketch E100-1 for clarification).

ARCHITECTURAL SUBSTITUTION REQUESTS -- APPROVED

ADD 1-6 Subject to compliance with the requirements in the specifications and shop drawing review, the following substitutions have received pre-approval for bidding purposes:

- a. 074113 – Metal Roof Panels: Firestone Unaclad UC-14 (w/custom color)

MECHANICAL SUBSTITUTION REQUESTS -- APPROVED

ADD 1-7 Subject to compliance with the requirements in the specifications and shop drawing review, the following substitutions have received pre-approval for bidding purposes:

<u>Equipment List</u>	<u>Manufacturer List</u>
a. Grilles, Registers, Diffusers	Price
b. Exhaust Fans	Acme, Loren Cook
c. Louvers	Ruskin

ELECTRICAL SUBSTITUTION REQUESTS -- APPROVED


ADD 1-8 Subject to compliance with the requirements in the specifications and shop drawing review, the following substitutions have received pre-approval for bidding purposes:

<u>Equipment List</u>	<u>Manufacturer List</u>
a. Light Fixture #2	Columbia Lighting
b. Light Fixture #2E	Columbia Lighting
c. Light Fixture #3	Columbia Lighting
d. Light Fixture #4	Dual-Lite

End of Addendum #1


Attachments:

- Sketch A1
- Sketch E100-1

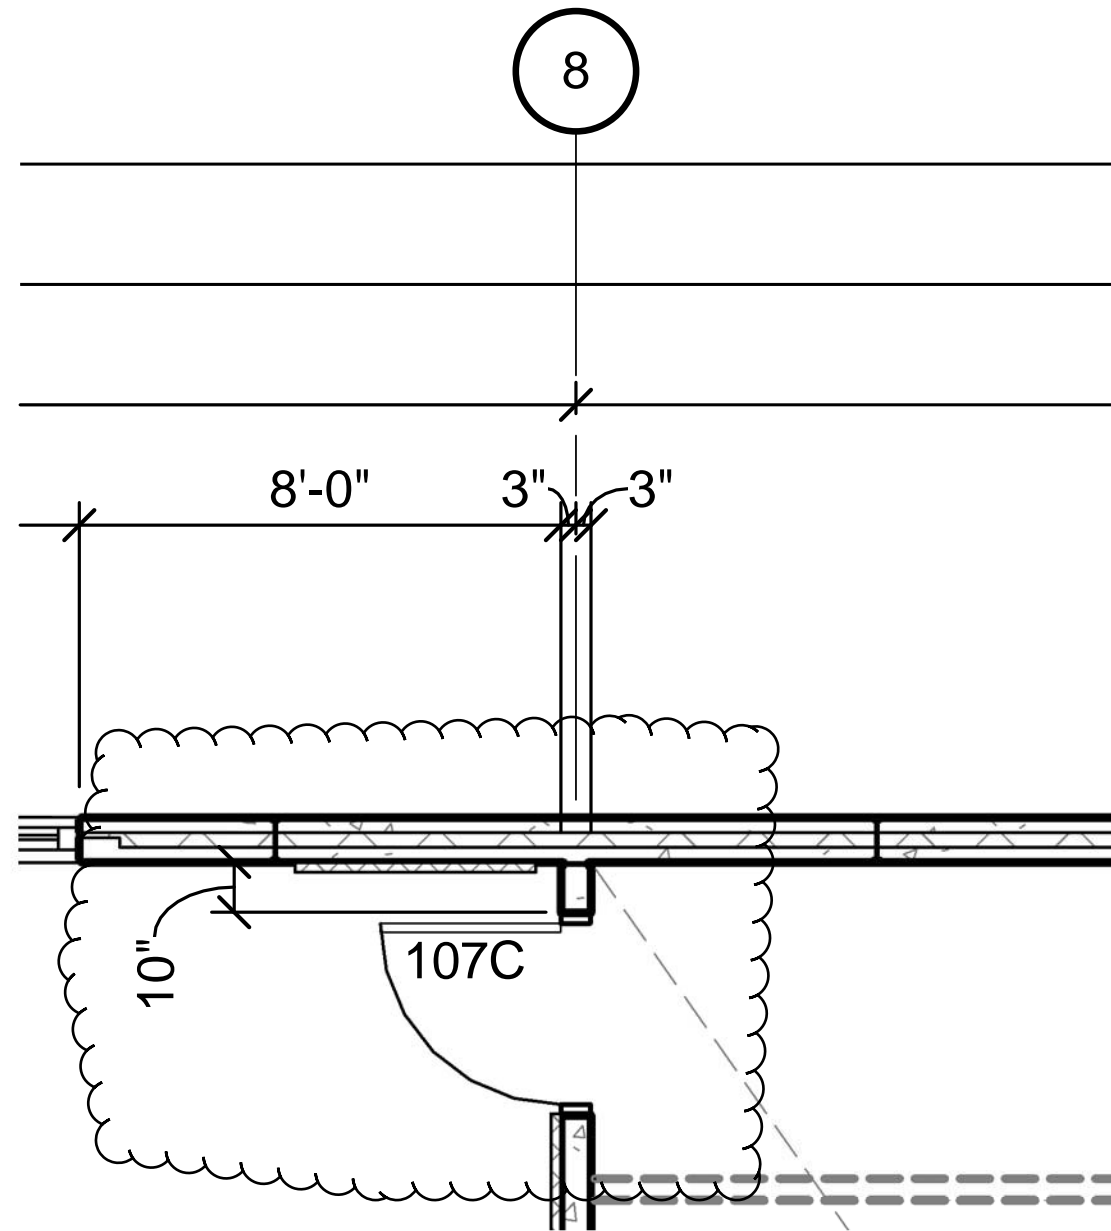

NDOR - Gordon Equipment Storage Building and Wash Bay
NDOR Bldg. No. 50905
AFE K-500

Sketch A1
Addendum #1

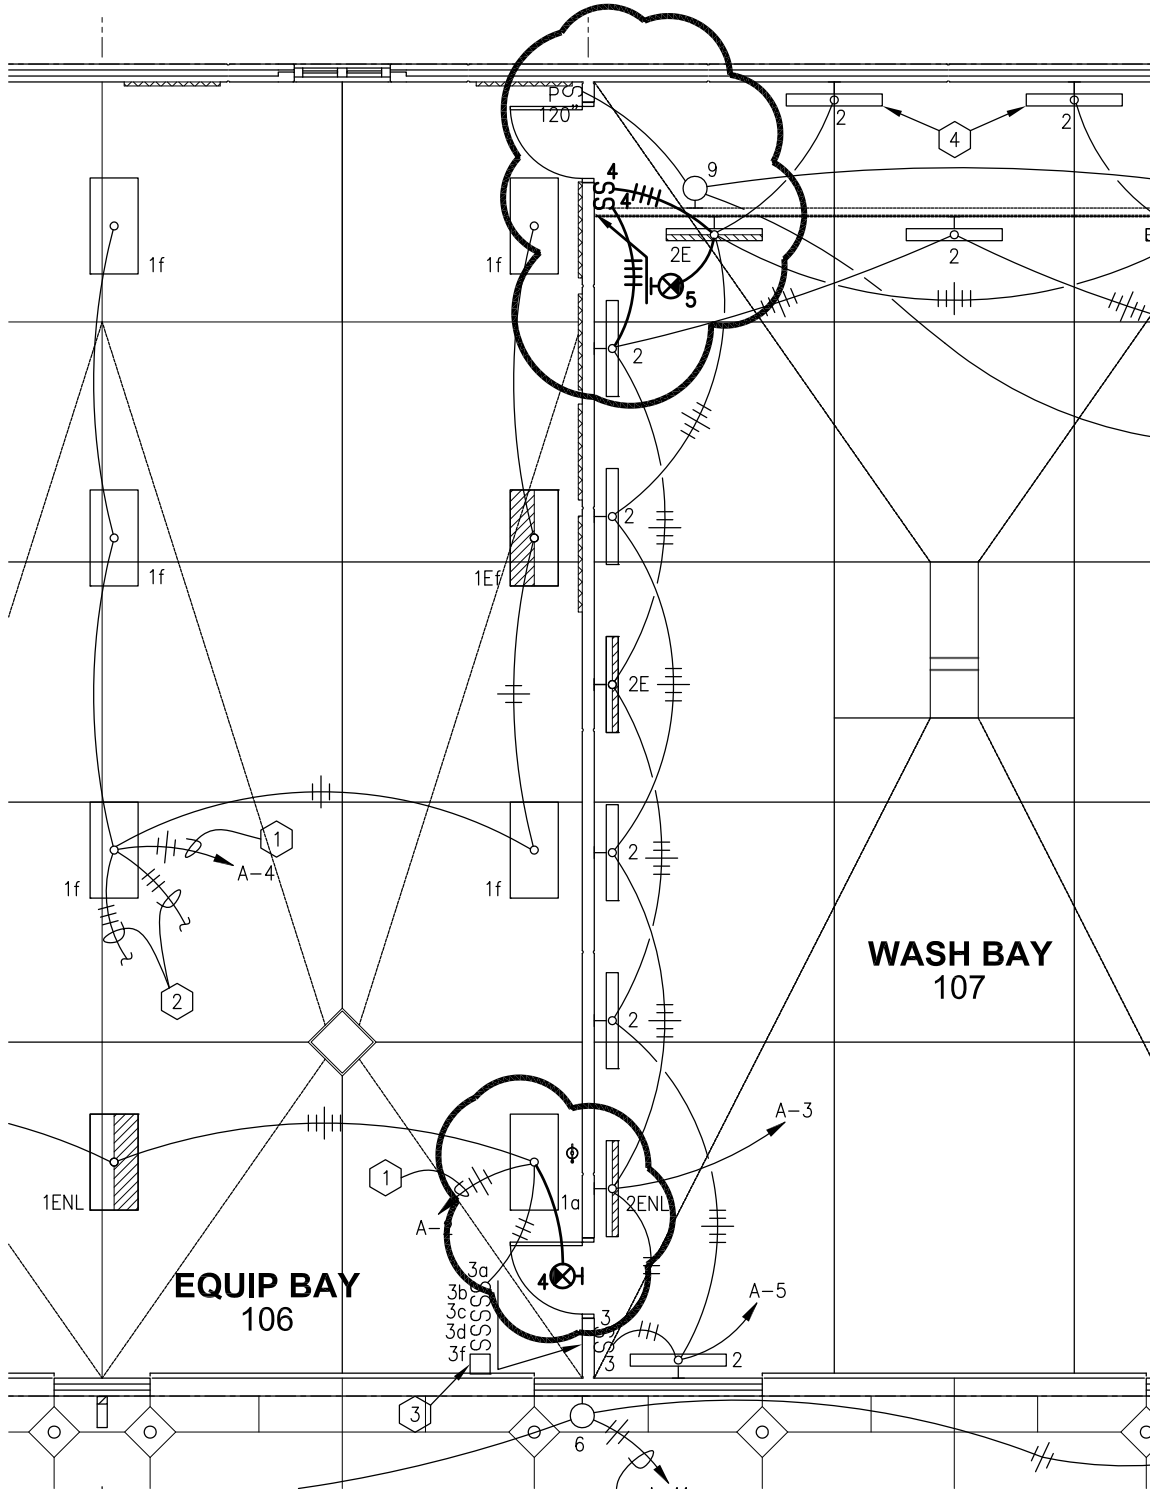


NDOR STORAGE BLDG. -
 GORDON, NE
 FLOOR PLAN - LIGHTING



SCALE: 1/8" = 1'-0"

BJF



Engineering Technologies Inc.
 Mechanical & Electrical Building Solutions

825 M Street, Suite 200 | Lincoln, NE 68508
 P 402.476.1273 | F 402.476.1274

1111 N. 13th Street, Suite 216 | Omaha, NE
 68102 | P 402.330.2772 | F 402.330.2630

ETI Project No: (2013-034)

ADDENDUM #1

SHEET
E100

ATTACHMENT NO.

1

02/11/14