



DATE ISSUED March 22, 2016

ADDENDUM # 1

ENGINEER Engineering Technologies, Inc.
825 M Street, Suite 200
Lincoln, NE 68508

PROJECT Culler Middle School Generator Replacement

ETI PROJECT # 2016-028

The Architect issues this Addendum to all known bidders before receipt of proposals. Bidder shall acknowledge the receipt of this addendum on their proposal sheet and all information contained herein shall become a part of the contract documents.

ADDENDUM:


GENERAL ITEMS

- 1. Roof Detail
 - A. The attached roof curb detail shall apply to the roof work associated with the generator replacement.
- 2. Prebid Sign In Sheet
 - A. The sign in sheet for the Prebid meeting is attached.
- 3. Prebid date confirmation.
 - A. The agenda that was handed out at the Prebid meeting had the wrong date listed for the bid date. The bid date is correctly listed in the specifications and on A&D's website which is March 31, 2016 @ 2:30pm.

GENERAL ITEMS – MECHANICAL

- 1. Generator Exhaust
 - A. The new exhaust shall be 3 in. For clarification the existing portion of the exhaust that is going through the roof is also 3 in.

END OF ADDENDUM

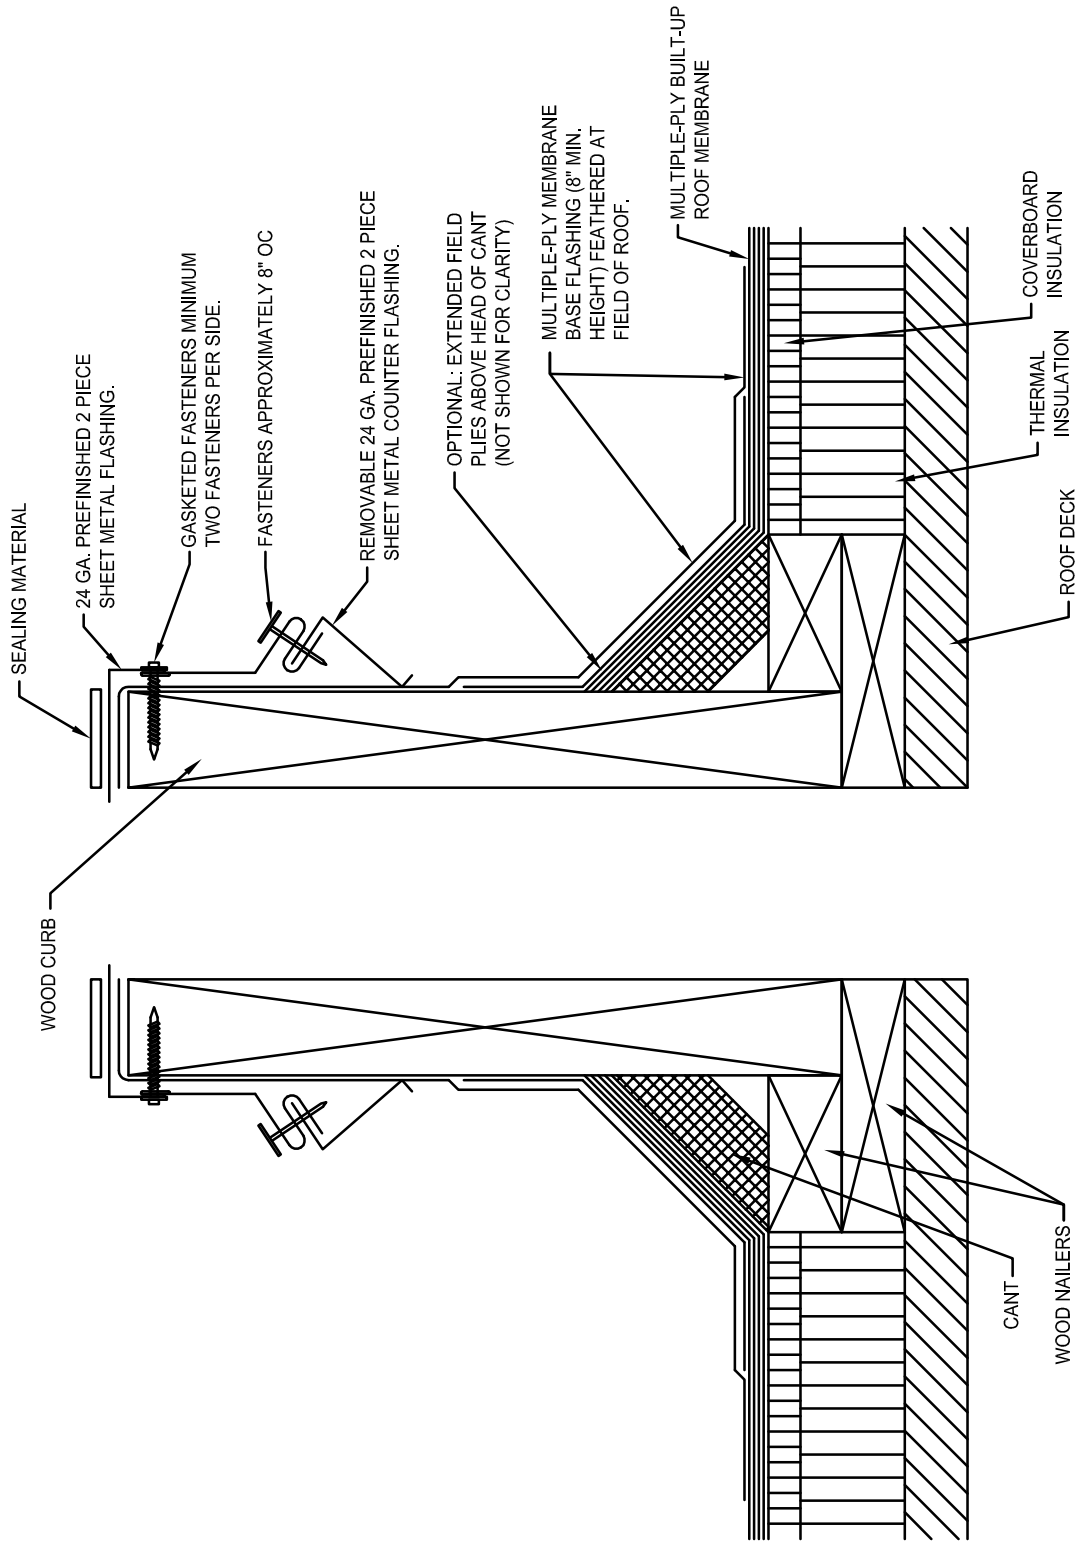


ROOF CURB DETAIL

NO SCALE

**CULLER MIDDLE SCHOOL
GENERATOR REPLACEMENT
ROOF CURB DETAIL**

SCALE: NONE



Engineering Technologies Inc.
Mechanical & Electrical Building Solutions
825 M Street, Suite 200 | Lincoln, NE 68508
P 402.476.1273 | F 402.476.1274
1111 N. 13th Street, Suite 216 | Omaha, NE
68102 | P 402.330.2772 | F 402.330.2630
ETI Project No: (2016-028)

ADD #1
SHEET
M1.0
ATTACHMENT NO.
1
03/11/16

